

Hydropower Project Summary

MOKELUMNE RIVER, CALIFORNIA

MOKELUMNE RIVER HYDROELECTRIC PROJECT (P-137)



Salt Springs Dam on North Fork Mokelumne River

Photo Credit: kids.brittanica.com

This summary was produced by the

Hydropower Reform Coalition

and

River Management Society

MOKELUMNE RIVER, CA

MOKELUMNE RIVER HYDROELECTRIC PROJECT (P-137)

DESCRIPTION:

The Mokelumne Project is located on the Mokelumne, North Fork Mokelumne (North Fork), and Bear Rivers and tributaries of the North Fork in the Sierra Nevada mountain range of California. Portions of the project occupy lands within the Stanislaus and Eldorado National Forests, and lands managed by the U.S. Department of the Interior's Bureau of Land Management (BLM).

Farthest upstream are four natural lakes which have been enlarged by the addition of dams to Upper Blue Lake, Lower Blue Lake, Twin Lake, and Meadow Lake. The project has four power developments downstream of these lakes: Salt Springs, Tiger Creek, West Point, and Electra.

The nine signatories to the Settlement are: U.S. Forest Service (Forest Service), U.S Fish and Wildlife Service (FWS), BLM, California Dept. of Fish and Game (Cal Fish and Game), California Dept. of Boating and Waterways (Cal Boating), Friends of the River, Natural Heritage Institute, American Whitewater, and Foothill Conservancy.

The California State Water Resources Control Board and the East Bay Utility District were members of the collaborative process during licensing but did not sign the Settlement.

A. SUMMARY

1. License application filed: 1972 with amendments in 1978, 1981, 1985, and 1996
2. License Issued: October 11, 2001
3. License expiration: October 11, 2031
4. Waterways: Mokelumne, North Fork Mokelumne (and its tributaries), and Bear Rivers
5. Capacity: 206 megawatt (MW)- increase to 210.7 MW
6. PG&E: Pacific Gas & Electric Company (PG&E)
7. PG&E address: Pacific Gas & Electric Company
245 Market Street
San Francisco, CA 94105
8. Counties: Alpine, Amador, and Calaveras


9. Project Area: The farthest upstream area includes four natural lakes, enlarged by the addition of dams; Upper Blue Lake (7,300 acre-feet of storage); Lower Blue Lake (5,091 acre-feet); Twin Lake (1,207 acre-feet); and Meadow Lake (5,656 acre-ft). The outflow from these lakes reaches the North Fork via Deer Creek. Twin Lake drains into Meadow Creek, which drains into Meadow Lake, and which finally drains into the North Fork. The project has four power developments downstream of these lakes: Salt Springs, Tiger Creek, West Point, and Electra.
10. Project Facilities: The existing Mokelumne River Project consists of seven storage reservoirs, four powerhouses, and numerous diversions and conduits [See **Figure 1**]. The seven storage reservoirs include:
- 343-acre Upper Blue Lake with a useable storage capacity of 7,300 acre-feet, and an 837-foot-long, 31-foot-high dam;
 - 198-acre Lower Blue Lake with a useable storage capacity of 5,091 acre-feet, and a 1,063-foot-long, 40-foot-high dam;
 - 106-acre Twin Lake with a useable storage capacity of 1,207 acre-feet, and a 1,520-foot-long, 22-foot-high dam;
 - 140-acre Meadow Lake with a useable storage capacity of 5,656 acre-feet, and a 775-foot-long, 77-foot-high dam;
 - 169-acre Upper Bear River reservoir with a useable storage capacity of 6,756 acre-feet, and a 760-foot-long, 77-foot-high dam;
 - 727-acre Lower Bear River reservoir with a useable storage capacity of 49,079 acre-feet, and a 979-foot-long, 249-foot-high dam connected by rock to a 865-foot-long, 145-foot-high second dam; and,
 - Lake Tabeaud.

The four power developments are Salt Springs, Tiger Creek, West Point, and Electra.

- a. Salt Springs Development includes:
- a 1,257-foot-long, 328-foot-high dam with a 480-foot-long spillway and 13 radial gates;
 - the 963-acre Salt Springs reservoir with a useable storage capacity of 141,817 acre-feet;
 - a 19-foot-long, 10-foot-diameter buried penstock;
 - a powerhouse with two turbine generators with a combined capacity of 43.5 megawatts (MW);
 - a 16.5-mile-long, 115 kilovolt (kV) transmission line; and appurtenant facilities.

- b. Tiger Creek Development includes:
- the upper Tiger Creek conduit comprised of 14.8 miles of flume, 2.7 miles of tunnel, and 0.3 mile of penstock;
 - the lower Tiger Creek conduit, which is a 2.5-mile-long flume receiving water from six diversion dams and any associated structures, including:
 - the 187-foot-long Cole Creek diversion dam;
 - the 91-foot-long Cole Creek feeder dam, and a 315-foot-long, 3- and 5-foot-diameter penstock;
 - the 102-foot-long Bear River feeder dam, and a 528-foot-long, 6-foot horseshoe tunnel, and 737-foot-long flume;
 - the 43-foot-long Beaver Creek feeder dam, and a 475-foot-long, 16-inch-diameter penstock;
 - the 64-foot-long East Panther Creek feeder dam, and a 635-foot-long, 36-in-diameter penstock; and,
 - the 58-foot-long West Panther Creek feeder dam and a 3,393-foot-long penstock.
 - the 486-foot-long, 100-foot high Tiger Creek regulator dam;
 - a 13-acre reservoir with a useable storage capacity of 234 acre-feet;
 - the 900-foot-long, 33-foot-high Tiger Creek forebay dam;
 - a 2.3 acre reservoir with a useable storage capacity of 42 acre feet;
 - a 96-inch diameter penstock and a 24-inch diameter sluice penstock;
 - a powerhouse with two turbine generators with a combined capacity of 54.4 MW; and,
 - a 13.8-mile-long and 23.4-mile-long, 320 kV transmission line and appurtenant facilities.
- c. West Point Development includes:
- The 448-foot-long, 100-foot-high Tiger Creek afterbay dam;
 - a 70-acre reservoir with a useable storage capacity of 2,606 acre-feet;
 - the 15-foot, 6 inch by 13-foot, 2.7 mile-long West Point tunnel;
 - a 84- and 120-inch diameter penstock;
 - a powerhouse with a turbine generator with a capacity of 14.1MW; and,
 - a 23.5-mile long, 60kV transmission line and appurtenant facilities.
- d. Electra Development includes:
- the 188-foot-long, by 26-foot-high Electra diversion dam;
 - the 15-foot, 6 inch by 13-foot, 8 mile-long Electra tunnel
 - the 636-foot-long, 123-foot high Lake Tabeaud dam;
 - a 42-acre reservoir with useable storage capacity of 990-acre feet;
 - the 12-foot by 12-foot, 0.5 mile-long Tabeaud tunnel;
 - a powerhouse with three turbine generators with a combined capacity of 105.3 MW;

- the 319-foot-long by 37-foot high Electra afterbay dam; and,
- two 230 kV taps connecting the station to the Tiger Creek-Newark Transmission line and appurtenant facilities.

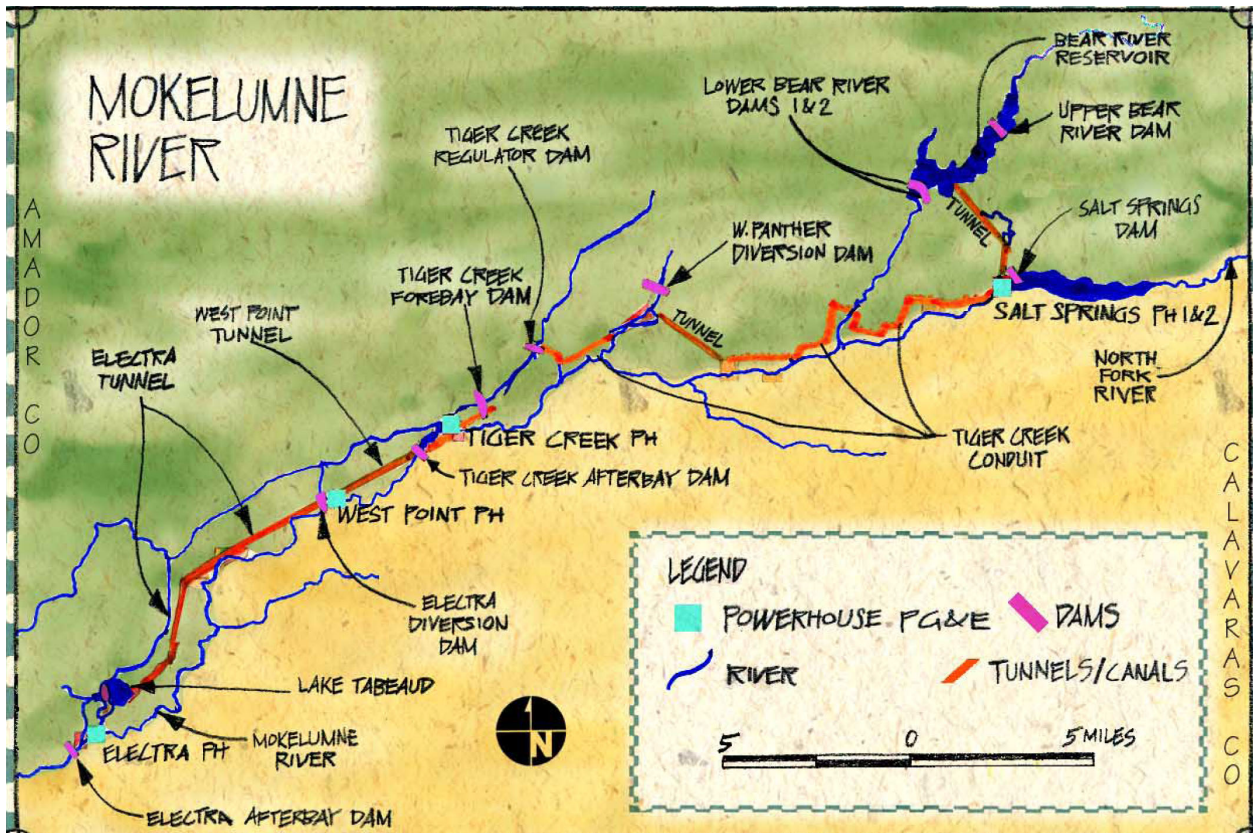

[Courtesy of California Hydropower Reform Coalition]

FIGURE 1

B. IMPORTANT PROVISIONS AND REQUIREMENTS IN LICENSE

The license requires numerous enhancements to the existing aquatic and terrestrial environments, recreation, and cultural resources. Many of the most important license requirements fall into two categories included in the Appendix which contains the FPA (Federal Power Act) Section 4(e)/FPA Section 10(a)1 Terms and Conditions submitted by the Forest Service:

- 1) Biological Resource Management includes minimum stream flows, pulse flows, ramping rates, an ecological resource adaptive management program, breaching of three dams (East Panther, West Panther, and Beaver Creek diversion dams), and minimum pool levels;
- 2) Recreation Resource Management includes an implementation plan, review of recreation developments, recreation streamflows, whitewater boating monitoring and adjustment of recreation streamflows, and whitewater boating access facilities.

1. **Biological Resource Management** [See **Table 1** for License References]
The license requires thirteen provisions as listed in **Table 1** for biological management.

Table 1: Biological Resource Management References

Appendix Condition No.	Description
5	Minimum streamflows
6	Pulse flows
7	Operation of upper lakes
8	Limitation on short-term power generation water releases during summer
9	Ramping rates
10	Ecological resource adaptive management program
11	Water quality
12	Breaching of East Panther, West Panther, and Beaver Creek diversion dams
13	Minimum pools
14	Mitigation of entrainment
15	Wildlife and sensitive plant protection measures
16	Annual review of biological conditions
17	Noxious weeds

As part of on-going monitoring of all of license provisions, each calendar year by April 1, PG&E is required to schedule and facilitate a meeting with the Forest Service to review and discuss the results of implementing these provision specified in the Conditions as well as to discuss other issues related to preserving and protecting fish and wildlife values affected by the Project.

Also as part of the license (Condition 12) is the requirement to remove or breach the Tiger Creek Canal Feeder Diversion Dams (East Panther and West Panther Creeks) and dismantle certain existing diversion features at Beaver Creek Diversion Dam as described in the Breaching for East and West Panther Diversions and Dismantling of Beaver Creek Diversion Plan provided in the Settlement. This was completed in 2003.

Many of the provisions fall into two main categories: streamflow and associated lake level regulation, and ecological resource adaptive monitoring and management.

a. Streamflow

Minimum streamflows, pulse flows, and ramping rates and associated schedules are specified in their corresponding Conditions (See **Table 1**) for the following:

- Bear River below Lower Bear River Reservoir Dam;

- Cole Creek below Bear River Tunnel Diversion;
- North Fork Mokelumne River below Salt Springs Reservoir Dam;
- North Fork Mokelumne River below Tiger Creek Afterbay Dam;
- North Fork Mokelumne River below Electra Diversion Dam; and
- Tiger Creek below Tiger Creek Regulator Dam.

The schedules are affected by the water year type: Wet, Above Normal (AN), Below Normal (BN), Dry, and Critically Dry (CD). PG&E determines water year type based on the predicted unimpaired inflow to Pardee Reservoir (Pardee) and spring forecasting information provided by the PG&E and the California Department of Water Resources snowpack forecasts each month from February through May. The water year types are defined in **Table 2**.

Table 2: Year Type Forecasts for the North Fork Mokelumne River

Year Type	Mokelumne River Water Year Forecast
Wet	Greater than or equal to 958,700 AF inflow to Pardee
Above Normal (AN)	Less than 958,700 AF but greater than or equal to 724,400 AF inflow to Pardee
Below Normal (BN)	Less than 724,400 AF but greater than or equal to 518,100 AF inflow to Pardee
Dry	Less than 518,100 AF but greater than or equal to 376,100 AF inflow to Pardee
Critically Dry (CD)	Less than 376,100 AF inflow to Pardee

AF- acre feet

Each February through May, PG&E is required to make a monthly forecast of the water year type and operate for that month, beginning on or before the 5th day of these 4 months (February through May), after forecasting information is available, based on that forecast. The May forecast is used to establish the final water year type for the remaining months of the year until the next February. Salt Spring Reservoir is expected to spill in Wet, AN, and BN years but not expected to spill in Dry and CD years.

PG&E is required to provide annual pulse flow events by water year type in the same waterways as required of minimum flows with specified duration and timing.

For the North Fork Mokelumne below Salt Springs Reservoir and Bear River below Bear River Reservoir, consideration is given for the timing of the continuous 5-day pulse event to occur over a weekend during the whitewater boating season [See **Recreation Resource Management**].

As part of the operation of the Upper Lakes, releases from Upper Blue Lake, Lower Blue Lake, Twin Lake, and Meadow Lake are specified to meet targeted streamflow to maintain natural stream ecology by mimicking the natural hydrograph with balancing inflows and outflows during the year. Additionally, water quality including dissolved oxygen and water temperature monitoring is required to meet the mean daily water temperature of 20°C or less to protect temperature of cold-water habitat for the following:

- Blue Creek between Upper Blue Lake Dam and Lower Blue Lake;
- Blue Creek between Lower Blue Lake Dam and Deer Creek;
- Meadow Creek between Meadow Lake Dam and North Fork Mokelumne River;
- Cole Creek between Bear River Tunnel Diversion and North Fork Mokelumne River;
- Bear River between Lower Bear River Reservoir Dam and North Fork Mokelumne River;
- Tiger Creek between Tiger Creek Regulator Dam and Tiger Creek Afterbay; and,
- North Fork Mokelumne River between Salt Springs Reservoir Dam and Tiger Creek Afterbay.

b. Ecological Resource Adaptive Monitoring and Management

This consists of:

1. Formation of an Ecological Resources Committee (ERC);
2. Implementation of a stream ecology monitoring program;
3. Specific adaptive management measures that are implemented if the ERC and FS determine through the monitoring program and other scientific information that the applicable ecological resource objectives will likely not be met without adjustment of the initial streamflows and other initial protection, mitigation, and enhancement measures; and,
4. A Protection, Mitigation, and Enhancement Fund that is available to address other items.

The ecological resources adaptive management program provides for an initial set of minimum streamflows and pulse flows to be implemented for a 5-year period, followed by two successive 5-year periods with potentially modified streamflow regimes, and potentially modified streamflow regimes thereafter. The exception to this 5-year implementation schedule is the potential release of additional water for water temperature control, which will be available upon implementation of the initial minimum streamflows. Monitoring is required during each of these periods to determine if the applicable ecological resource objectives are achievable and being met. Analysis of the monitoring results

from a given 5-year period will be used to determine any needed changes in streamflow for the next 5-year periods and thereafter..

Adaptive management decisions will be based on monitoring results and other scientific information and a determination by the ERC and FS that the applicable ecological resource objectives will likely not be met without application of the adaptive management measures. The adaptive management program allows for streamflow adjustments to be made after each 5-year monitoring period. It is the intent of the adaptive management program to maintain consistent streamflow regimes during each 5-year period for the purposes of scientific study under the ecological resources monitoring program described in this condition. However, adjustments in streamflow during any 5-year period are allowed based on monitoring or other scientific information if the ERC and the FS determine that more frequent streamflow adjustments are necessary with the goal of meeting the applicable resource objectives as described in the Settlement.

For purposes of the ecological resources adaptive management program, each year is defined on a calendar year basis (i.e., January through December). Year 1 is defined as the first year during which the initial minimum streamflows required by the license are implemented by May 1. For example, if the initial minimum streamflows are implemented for the first time in April, that year is defined as Year 1. If, however, the initial minimum streamflows are implemented for the first time in June, then the following calendar year is defined as Year 1.

PG&E is required [Reference: Article 402 of the license] to establish a tracking account for the purpose of funding resource monitoring beyond that specified in the Settlement Agreement including monitoring after year 15 of the license as well as non-flow protection, mitigation, and enhancement (PM&E) measures beyond those specified. This tracking account (PM&E Fund) will be established in the amount of \$1,500,000. The initial amount may be increased by up to \$250,000 six years after license issuance for the purpose of funding development of a project reservoir temperature model, provided the ERC and FS make an affirmative determination, based on the first five years of monitoring results, that such a model is necessary to achieve the water temperature criterion stated in Condition No. 11. The initial amount may also be increased by up to \$250,000 six years after license issuance for the purpose of funding PM&E measures for riparian restoration in project-affected stream reaches, provided the ERC and FS make an affirmative determination, based on the first five years of monitoring results, that such PM&E measures for riparian restoration are necessary to

achieve the applicable Riparian Habitat Objective. The unspent balance of the PME fund will accrue interest at the 90-day commercial paper rate as determined by the Federal Reserve Bank of New York, credited on a quarterly basis.

2. Recreation Resource Management

The license requires fifteen provisions as listed in **Table 2** for recreation resource management.

Table 2: Recreation Resource Management References

Appendix Condition No.	Description
18	Implementation plan
19	Recreation use
20	Review of recreation developments
21	Forest service liaison
22	Salt Springs Reservoir boating safety and litter clean-up
23	Archaeological surveys and evaluations in Mokelumne Canyon
24	Stump removal
25	Fence repair
26	Blue Lakes unit recreation facilities
27	Lower Bear River Reservoir unit recreation facilities
28	Recreation streamflows in BN, AN and Wet water years
29	Recreations streamflows in Dry and CD years
30	Whitewater boating monitoring and adjustment of recreation streamflows
31	Streamflow information
32	Whitewater boating access facilities

The majority of the provisions fall into two main categories: 1) general recreation such as camping, picnicking and hiking and 2) whitewater boating.

a. General Recreation

The license requires that PG&E meet with the Forest every 5 years to review Project-related recreation areas on National Forest System lands and adjoining PG&E fee title property to agree upon rehabilitation and reconstruction work needed and its timing. The type of rehabilitation/reconstruction work needed is dependent on the amount and type of use, current recreation facility policy, condition of facilities, impacts to surrounding areas, and other factors. Accordingly, PG&E is required to record recreation use annually at each of the developed campground sites it operates including:

- Upper Blue Lake Dam Campground;
- Upper Blue Lake Campground
- Middle Creek Campground; and

- Lower Blue Lake Campground.

The data collected should determine number of turn-away days and site occupancy rate during the operating season. When the data indicates a rising number of turn-away days and the average area occupancy rate in any site is in excess of 70 percent for 2 consecutive years, the Forest Service and PG&E will jointly determine whether additional recreation facilities or other options are necessary, consistent with the carrying capacity of the area, which is 1,000 persons at one time (PAOT).

PG&E is also required to perform annual random user counts and at least once every 5 years, complete a survey at the following sites:

- Lower Blue Lake Picnic Area;
- Lower Blue Lake Dam Fishing Access/Picnic Area;
- Lower Blue Lake Dam Boat Launch/Picnic Area;
- Twin Lake Picnic Area;
- Parking lot near Meadow Lake;
- Granite Lake Trailhead; and,
- Pacific Crest Trail staging area north of Upper Blue Lake Campground.

The survey will determine trends of use, the number of days parking capacity is met or exceeded, and whether resource damage is occurring. When the data indicate a rising number of turn-away days and the average area occupancy rate in any site is in excess of 70 percent for 2 consecutive years, the Forest Service and PG&E will jointly determine whether additional recreation facilities or other options are necessary, consistent with the carrying capacity of the area.

The PG&E shall complete a survey at least once every 5 years at Salt Springs Picnic Area and Blue Hole Trailhead. The survey will determine trends of use, the number of days parking capacity is met or exceeded, and whether resource damage is occurring. When the data indicate that the average occupancy rate during peak days in the high use season is in excess of 70 percent, the Forest Service and PG&E will jointly determine whether additional recreation facilities or other options are necessary, consistent with the carrying capacity of the area.

The license also requires specific upgrades for the following:

1. *Salt Springs Reservoir*
PG&E is required to allow limited car top boating on Salt Springs Reservoir and maintain safety related facilities for that use. PG&E

is also required to provide general policing along the shoreline from the waterline to approximately 100 feet from the water line with a focus on camping areas to clean up litter.

2. *Blue Lakes Unit Recreation Facilities*

Improvements range from visitor information signage to additional picnic, parking areas, and campground expansion. The Unit facilities include:

- Twin Lake Facilities;
- Lower Blue Lake Dam Fishing Access;
- Lower Blue Lake Dam Boat Launch and Picnic Area;
- Lower Blue Lake Picnic Area; and,
- Middle Creek Campground.

PG&E is responsible for funding and performing design, construction, operation, and maintenance of all Project-related recreation facilities in the Blue Lakes area with the exception of 30 percent of the construction costs of the Blue Lakes kiosk. PG&E is also required to contribute annually by October 1 the amount of \$8,300 (year 2000 cost basis) for the Forest Service to perform site policing, maintenance, monitoring, and enforcement of dispersed public use sites (overnight camping and day use) on National Forest System lands adjacent to the Project area around Upper and Lower Blue Lakes, Twin Lake, and Meadow Lake. The costs shall be escalated based on the U.S. Gross Domestic Product — Implicit Price Deflator (GDP-IPD).

3. *Lower Bear River Reservoir Unit Recreation Facilities*

Improvements range from upgrading a number of existing campsites to meet American with Disabilities guidelines to construction of additional picnic units and campsites. The Unit facilities include:

- Sugar Pine Point Campground;
- Pardoes Point Campground and Picnic Area;
- Bear River Group Campground; and,
- South Shore Campground.

PG&E is responsible for funding and performing construction and future rehabilitation of all recreation facilities at Lower Bear River Reservoir within the Project boundary.

Rehabilitation is normally needed every 15-25 years and is defined as work that is necessary to keep existing facilities serviceable to meet Forest Service standards. The Forest Service is responsible for the performance of operation and maintenance of the Unit

campground and picnic areas. PG&E will contribute annually by October 1 the amount of \$8,000 per year (year 2000 cost basis) for the Forest Service to perform monitoring and permit compliance assurance for the campground concessionaire special use permit for the existing recreation facilities, including Sugar Pine Point Campground, the Pardoes Point Campground and Picnic Area, the Bear River Group Campground, and the South Shore Campground. The costs shall be escalated based on the U.S. Gross Domestic Product — Implicit Price Deflator (GPD-IPD).

PG&E will also contribute annually by October 1 the amount of \$8,300 (year 2000 cost basis) for the Forest Service to perform site policing, maintenance, monitoring, and enforcement of dispersed public use sites (overnight camping and day use) within the Project area around Upper and Lower Bear River Reservoirs. The costs shall be escalated based on the GDP-IPD. The Licensee shall provide a boat and operator at least once each season (time to be determined by mutual agreement between PG&E and the Forest Service) for the Forest Service to perform the site policing.

b. Whitewater Boating

The license specifies recreational whitewater releases and streamflows adjusted for water year type, streamflow information available to the public, as well as whitewater boating access facilities. All provisions for recreation streamflows are subject to the safe operability of the Project facilities and equipment necessary to provide such streamflows. PG&E is required to make a good faith effort to maintain the operability of such Project facilities and equipment and will not schedule discretionary outages of such Project facilities and equipment in conflict with providing the recreation streamflows. PG&E will make a good faith effort to make scheduled recreation streamflow releases on the days when such releases are forecast to occur.

1. *Recreation Streamflows in BN, AN, and Wet Water*

PG&E is required to release water stored in Salt Springs Reservoir and/or Lower Bear River Reservoir to result in streamflows of at least 900 cfs (700 cfs in BN years) on the following days, times, and runs in the period beginning two weekends prior to Memorial Day weekend and ending June 15 and prior to the start of spill at Salt Springs Reservoir Dam:

- a) two non-consecutive weekend days between 10 AM and 12 Noon at the Devils Nose Run whitewater boating put-in;

- b) three weekends of two consecutive weekend days (total of six days) between 10 AM and 2 PM at the Tiger Creek Darn Run whitewater boating put-in; and,
- c) one weekend day between 10 AM and 2 PM at the Ponderosa Way Run whitewater boating put-in.

If Salt Springs Reservoir begins to spill prior to completion of the scheduled water release days such that streamflows of at least 900 cfs (700 cfs in BN years) occur at the scheduled days, times, and reaches without releasing water, no further water releases are required for recreation.

However, whether resulting from water releases, spill flows, accretions, or a combination of the three, the actual days, times, and runs with streamflows of at least 900 cfs (700 cfs in BN years) will not be less than specified above unless due to circumstances beyond PG&E's reasonable control. In the event the specified number of days, times, and runs are not achieved, PG&E will provide 1 weekend day of streamflow of at least 700 cfs between 10 AM and 4 PM at the Electra Run whitewater boating put-in either in July, August, or September for each specified day not achieved. In scheduling water releases prior to the start of spill at Salt Springs Reservoir Dam, PG&E is required to give priority to Memorial Day weekend and days later in the specified period.

In addition to the streamflows specified above for the Devils Nose, Tiger Creek, and Ponderosa Way runs, PG&E will provide streamflows of at least 700 cfs between 10 AM and 4 PM at the Electra Run whitewater boating put-in an average of three out of every four weekend days between May 1 and June 15 and an average of two out of every four weekend days between June 16 and July 31.

2. *Recreation Streamflows in Dry and CD Water Years*

In Dry and CD water years, PG&E will provide recreation streamflows of at least 700 cfs between 10 AM and 4 PM at the Electra Run whitewater boating put-in an average of one out of every four weekend days between May 15 and June 30 and a minimum of 9 weekend days equally spread among the months of July, August, and September.

In Dry and CD water years, PG&E will provide recreation streamflows in the Devils Nose, Tiger Creek, and Ponderosa Way runs matching the days, times, and reaches specified for BN water

years upon a determination by the Ecological Resources Committee (ERC) and FS, for areas within its jurisdiction, that such streamflows can be provided without unacceptable environmental impact. If provided, these recreation streamflows will replace the recreation streamflows on the Electra Run in July, August, and September described in the immediately preceding paragraph. The determination made by ERC and FS shall be based on an investigation of the potential for ecologically suitable recreation streamflow based on monitoring identified in Condition No. 10. The initial evaluation and determination will be made within 3 years of license issuance. Absent a determination that such streamflows can be provided, PG&E shall annually request that the subject be reconsidered by the ERC and FS, for areas within its jurisdiction, for 10 years after the initial determination.

3. *Whitewater Boating Monitoring and Adjustment of Recreation Streamflows*

PG&G, in cooperation with FS and BLM, will monitor actual whitewater boating use of the Devils Nose, Tiger Creek, and Ponderosa Way runs for the purposes of:

- a) determining the adequacy of the 700 cfs specified initially for these runs in BN years and, to the extent streamflows in these runs are provided in Dry and CD years, for those years too;
- b) determining the adequacy of the 900 cfs specified initially for the Devils Nose Run in AN and Wet years; and,
- c) determining the appropriateness of the number of days of recreation streamflows specified for BN, AN and Wet water years and, to the extent recreation streamflows for these runs are provided in Dry and CD years, for those years too.

If, based on actual river boating use of any of the Devils Nose, Tiger Creek, and Ponderosa Way runs, FS or BLM determines that 700 cfs is inadequate for passage of rafts or inadequate for an acceptable whitewater boating experience on that run, the recreation streamflow provided for that run in BN, Dry, and CD water years will be increased from 700 cfs to a level adequate for rafts and adequate for an acceptable boating experience, provided that the required minimum streamflow at the put-in but not exceed 900 cfs (1,000 cfs for Devils Nose Run).

If, based on actual river boating use of the Devils Nose Run, FS determines that 900 cfs is inadequate for passage of rafts or

inadequate for an acceptable whitewater boating experience on that run, the recreation streamflow provided for that run in AN and Wet water years will be increased from 900 cfs to a level adequate for rafts and adequate for an acceptable boating experience, provided that the required minimum streamflow at the put-in but not exceed 1,000 cfs.

Each year, PG&E in cooperation with FS and BLM, will survey actual whitewater boating use of each of the Devils Nose, Tiger Creek, and Ponderosa Way runs on 4 random unannounced weekend days in May and June when streamflows are available, if less than 4) when streamflows of at least 700 cfs are forecast and available (or on the number of days such streamflows are available, if less than 4). After each 3-year cycle of surveys, PG&E will compile the survey data for the 3 most recent years for which data are available and shall provide copies to FS, BLM, AW, and other interested agencies and members of the public. If FS or BLM determine that actual surveyed whitewater boating use on a run exceeds the "add" trigger point for that run on at least 75% of the survey days for the 3-year period, the number of days PG&E will provide recreation streamflows for that run will be increased by 1 day. The trigger points for each run for adding 1 day are:

- Devils Nose Run, 27 boats;
- Tiger Creek Dam Run, 37 boats;
- Ponderosa Way Run, 30 boats.

The maximum number of days for each run are:

- Devils Nose Run, 8 weekend days over 4 weekends;
- Tiger Creek Dam Run, 10 weekend days over two, 2-day weekends and two, 3-day weekends (Friday, Saturday and Sunday);
- Ponderosa Way Run, 2 weekend days over two weekends.

The sequence for adding days is to add the maximum number of non-consecutive days first, then add the consecutive days.

If FS or BLM determines that actual surveyed whitewater boating use on a run on 75% of the survey days is not at least the "delete" trigger point for that run, the number of days PG&E will provide recreation streamflows for that run will be decreased by 1 day, provided that the number of days recreation streamflows are provided are not be less than the number of days specified initially for that run. The trigger points for each run for deleting 1 day are:

- Devils Nose Run, 7 boats;
- Tiger Creek Dam Run, 9 boats;

- Ponderosa Way Run, 7 boats.

The sequence for deleting days is the reverse of the sequence for adding days.

Boating use surveys may be discontinued by mutual agreement among PG&E, FS and BLM after consultation with AW and other interested members of the public. Additionally, the trigger points for adding or deleting days may be changed by mutual agreement among PG&E, FS, and BLM after consultation with AW and other interested members of the public, and with the concurrence of FERC, based on the carrying capacity of the resource.

The survey protocols and priorities among days of the week for adding or deleting days will be developed through consultation among PG&E, FS, BLM, AW, and interested members of the public. For the purposes of this paragraph, one raft or "cataraft" with a length of at least 10 feet counts as two boats. If the number of recreation streamflow days on any of the Devils Nose, Tiger Creek, or Ponderosa Way runs is increased from the specified initial number of days, the number of days of recreation streamflows specified for the Electra Run during July, August, and September in Dry and CD water years will be adjusted from the initial 9 days to the total number of recreation streamflow days for the upper three runs combined.

4. *Streamflow Information*

PG&E is required to make recreation streamflow information available to the public via toll-free phone and Internet from April 5 through October 31 each year. The phone information will consist of a "yes/no" forecast of whether recreation streamflow in the specified increments is anticipated to be available at the put-in for each of the Devils Nose, Tiger Creek Dam, Ponderosa Way, and Electra runs during the specified daytime periods. The flow increments will be 0 to 700 cfs, 700 to 3,100 cfs (in 800 cfs increments), and greater than 3,100 cfs. The daytime periods will be 10 AM to 2 PM for the Devils Nose Run and 9 AM to 3 PM for the other three runs. Forecasts will be updated each Thursday by 4 PM for the upcoming Friday, Saturday, and Sunday. Internet information shall consist of:

- a) the same forecast recreation streamflow information available by phone;
- b) daily updates of the readings of USGS gages 11314500 (PG&E gage M11), 11316600 (PG&E M38), 11316700

(PG&E gage M46), and 11316670 (PG&E gage M59) \pm 100 cfs at 9 AM, 12 Noon, and 4 PM and the estimated streamflow (or stream gage reading, if available) on the Electra Run \pm 100 cfs at 9 AM, 12 Noon, and 4 PM, as well as the time and magnitude of the maximum and minimum flow at each of these gages and the Electra Run between 9 AM and 4 PM, all for each of the prior 7 days;

- c) whenever Salt Springs Reservoir Dam is spilling, real time hourly updates from 7 AM to 11 AM of the readings of USGS gages 11314500 (PG&E gage M11), 11316600 (PG&E gage M38), 11316700 (PG&E gage M46), and 11316670 (PG&E gage M59) \pm 100 cfs; and,
- d) a forecast by April 5, with an updated forecast by May 5 and weekly updates thereafter through July 31 of the dates that PG&E anticipates streamflows will be in excess of 700 cfs due to spills and/or releases at the put-in for each of the upper three runs during the specified daytime periods.

Forecasts will be as accurate as reasonably feasible, recognizing that the forecasts and streamflows cannot be guaranteed and are subject to change.

5. *Whitewater Boating Access Facilities*

Construction of access facilities, funded by PG&E include the following:

- Devils Nose Run Put-in and Take-Out;
- Tiger Creek Put-in and Take-out;
- Ponderosa Way Put-in and Take-out;
- Electra Afterbay Dam Portage; and,
- Electra Run Put-in and Take-out.

6. *Contributions for River Rangers and Recreation Technician*

PG&E is required to contribute annually by January 15 the amount of \$25,000 (year 2000 cost basis) for BLM to provide two persons to act as River Rangers during the whitewater boating season. PG&E's contribution is contingent on the River Rangers providing an administrative presence on the four whitewater boating runs affected by the Project, including:

- assisting in monitoring the adequacy of recreation streamflows for an acceptable boating experience;
- monitoring whitewater boating use;
- evaluating carrying capacity thresholds;

- providing public safety information;
- general maintenance duties at put-ins and take-outs; and,
- other activities upon mutual agreement among PG&E, FS, and BLM.

PG&E will also contribute annually by October 1 the amount of \$10,000 (year 2000 cost basis) for FS to perform maintenance, monitoring and reporting activities related to the Devils Nose Run put-in not otherwise performed by the River Rangers, and contribute annually by January 15 the amount of \$5,000 (year 2000 cost basis) for BLM to perform maintenance activities at the Electra Run take-out not otherwise performed by the River Rangers.

C. MAP

There are two convenient ways to become familiar with this project on the Hydropower Reform Coalition website, www.hydroreform.org.

- Go directly to the project page <http://www.hydroreform.org/projects/mokelumne-river-p-137>.
- To understand the geographical context of the project, visit the *On Your River* section of the site. This link (<http://www.hydroreform.org/on-your-river/California>) will take you to the section for rivers in California. Zoom in until you can see Lake Tahoe on the California/Nevada border. P-137 is the second marker south of Lake Tahoe.

D. UPDATE

Post-license Activities: According to the Foothills Conservancy, ERC member:

- Ecological Review Committee is the post-license collaborative group. It meets monthly, occasional conference calls
- PG&E's "Tracking Account", a funding mechanism intended to cover implementation of various Settlement Agreement provisions, has been deferred until 2020
- ERC and Monitoring Reports are published within an internal/confidential Sharepoint site, not available to public.
- Annual Summary Reports are posted in FERC ELibrary during the first quarter of each year (last one in 2018)